

UHPLC CERTIFICATE OF ANALYSIS

SAMPLE INFORMATION


Sample received:

Product Name	AOD-9604 5mg Batch No. 96045
Sequence	H-Tyr-Leu-Arg-Ile-Val-Gln-Cys-Arg-Ser-Val-Gly-Ser-Cys-Gly-Phe-OH
Dissolution Condition	100% UHPLC water with 0.1% Trifluoroacetic Acid (TFA). Dissolved sample picture included here. 
Molecular Weight	~1,814.08 g/mol

STORAGE CONDITION: 0 °C

SAMPLE NOTES

One 3 ml clear glass vial with silver cap and silver aluminum crimp. Lyophilized powder present.

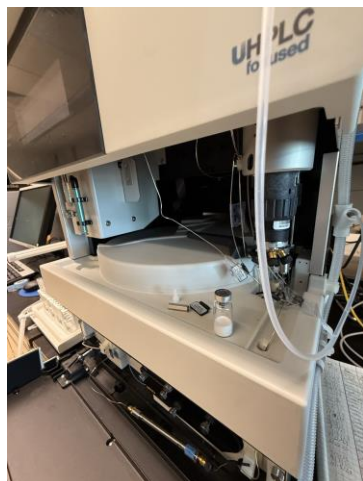

PUMP SETTINGS

Pump A	100% H2O with .1% Trifluoroacetic Acid
Pump D	100% Acetonitrile.
Column Usage	Agilent Zorbax 300SB-C18, 2.1 x 100 mm, 1.7 µm, 300 Å
Gradient	- 5% D hold (0–0.5 min) - 5 → 40% D over 10 min (≈3.5% D/min) - Hold 40% D (2 min) - Re-equilibrate to 5% D over 2.5 min - Total run time ≈ 15 min
Pump Settings	0.6 mL/min
Injection Volume:	10 µL
Temperature	30 °C


PURITY RESULT

Purity is **99.56%**

Product weight extrapolation: 5.4mg

Total impurity 0.44% (trace inert solvents and minor unidentified peaks; no significant related substances or degradation products detected above 0.1%).

Chromatogram Export: please note that x axis represents elution window.

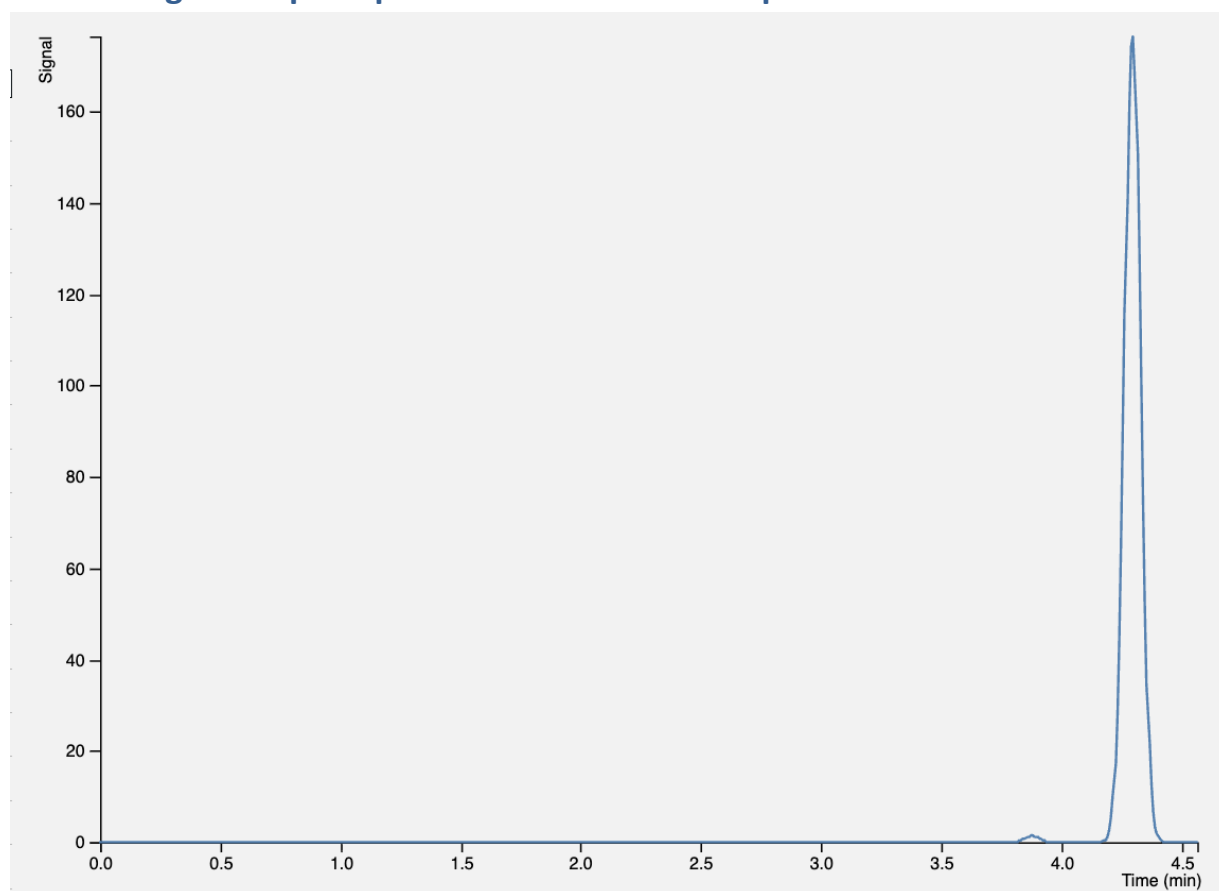

CONCLUSION

This sample was analyzed on a Thermo Ultimate U3000 HPLC stack using reverse-phase high-performance liquid chromatography and determined to contain **99.56% AOD-9604**, with the remainder being impurities of minor significance.

CERTIFICATION

Certified by: Jonathan Barber

Title: Analytical Chemist

Date: 13 September 2025



Trulab Peptides www.trulabpeptides.com | **Phone:** 872-239-6582

Address: 15017 North Dale Mabry Highway #1121 Tampa, FL 33618 United States